


RECORDED NOV 3 1981 at 3:38 P.M.

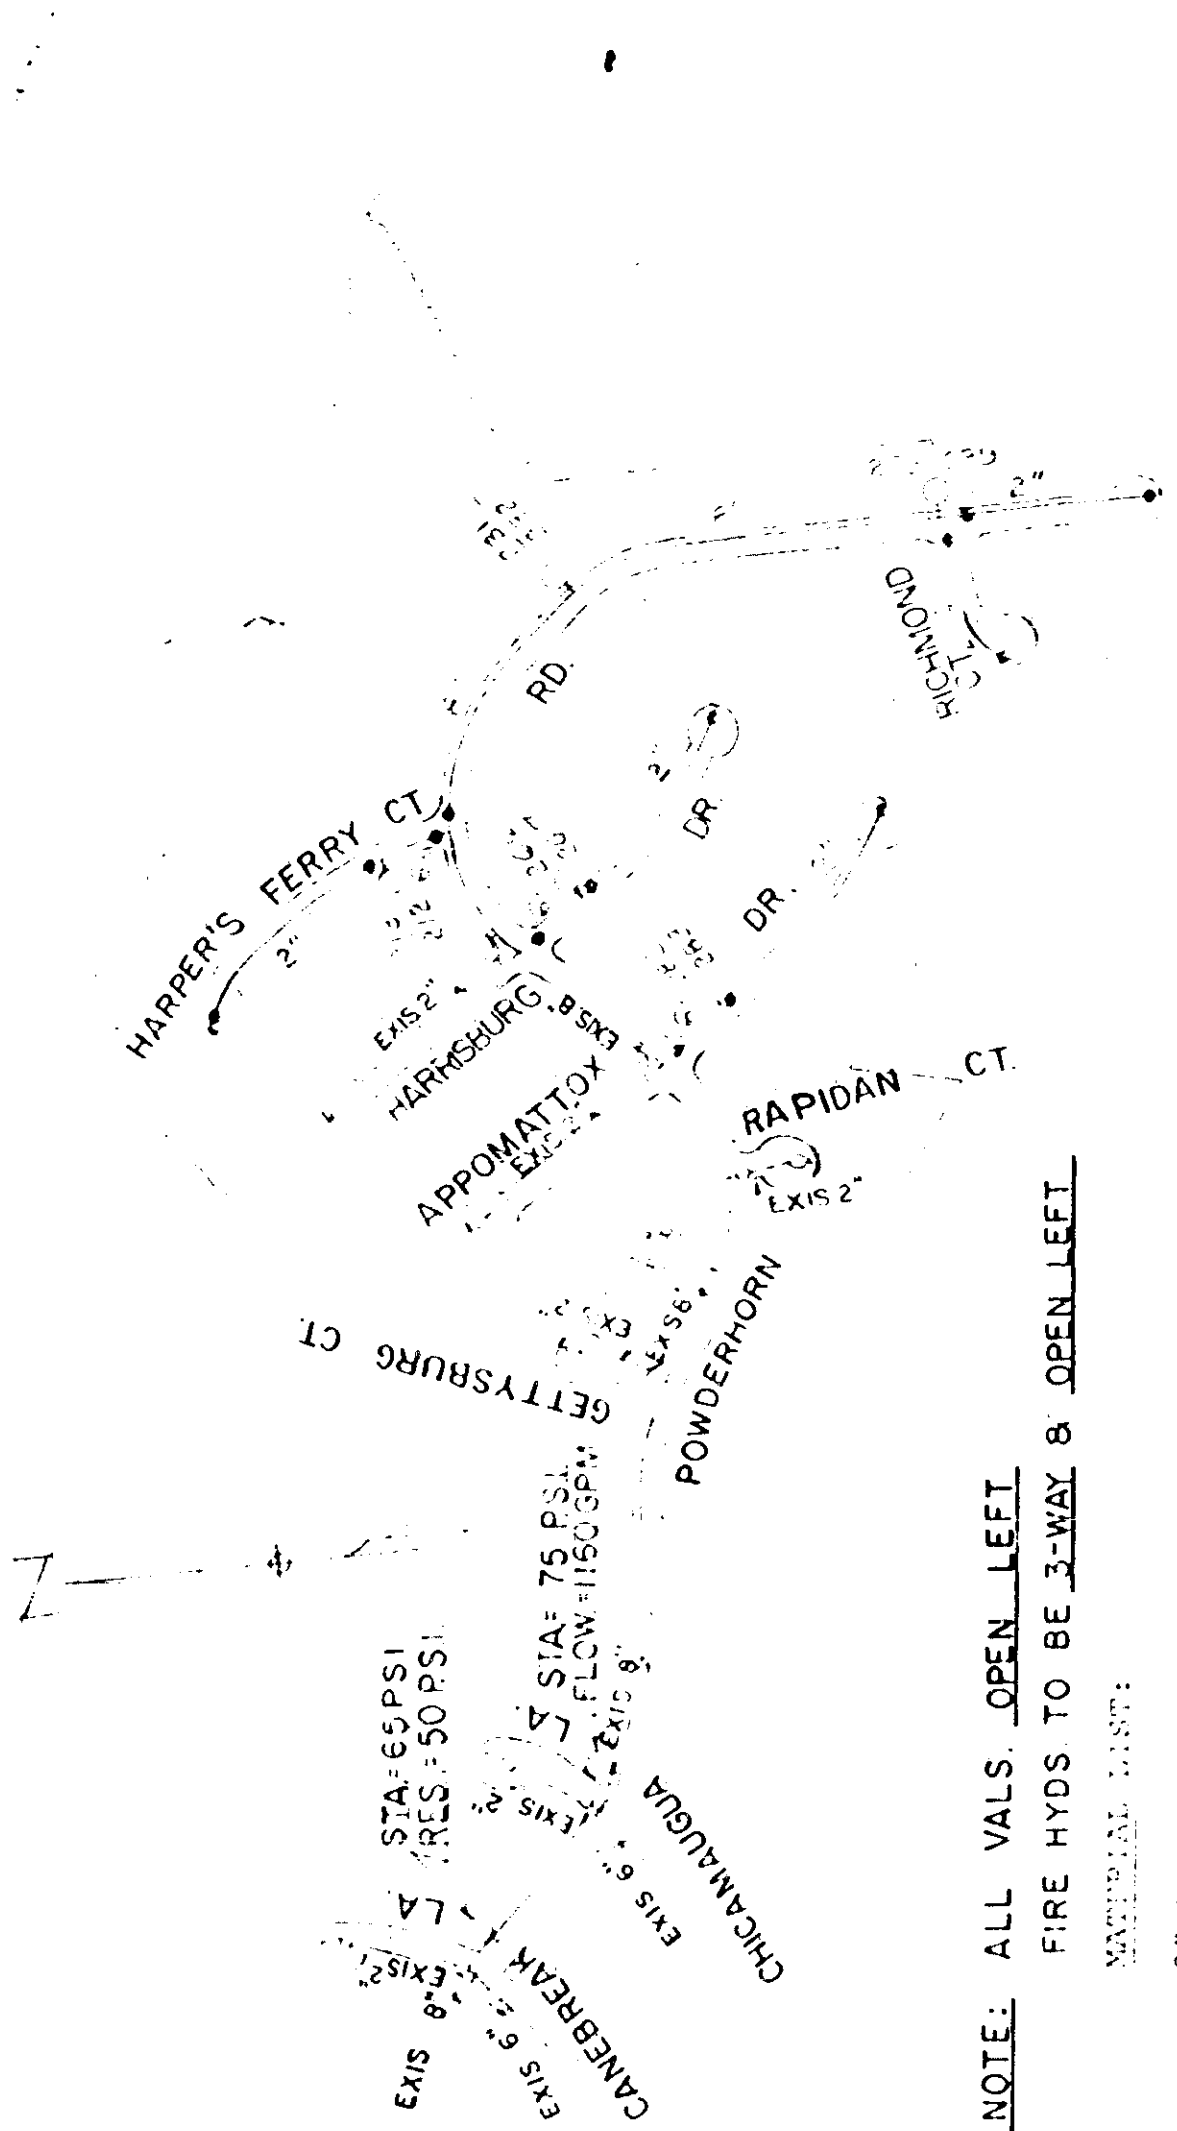

NOTE: ALL VALS. OPEN LEFT
 FIRE HYDS. TO BE 3-WAY & OPEN LEFT

MATERIAL LIST:

8" D. I. Pipe	-	1,380'±
6" D. I. Pipe	-	520'±
2" Galv. Pipe	-	2,070'±
8" Valves	-	1
6" Valves	-	8
2" Valves	-	10
Fire Hydrants	-	5

American Service Corporation
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 October 17, 1981
 S. C. W. P. No. 21-1-1-1

BOOK 1157 PAGE 711

POWDERHORN SEC. 4 MAP 2

DEC., 1980 SCALE 1" = 400'
 REVISED MAY 1981
 REVISED OCT 1981

11114

4328 RV-2

0714