


9434

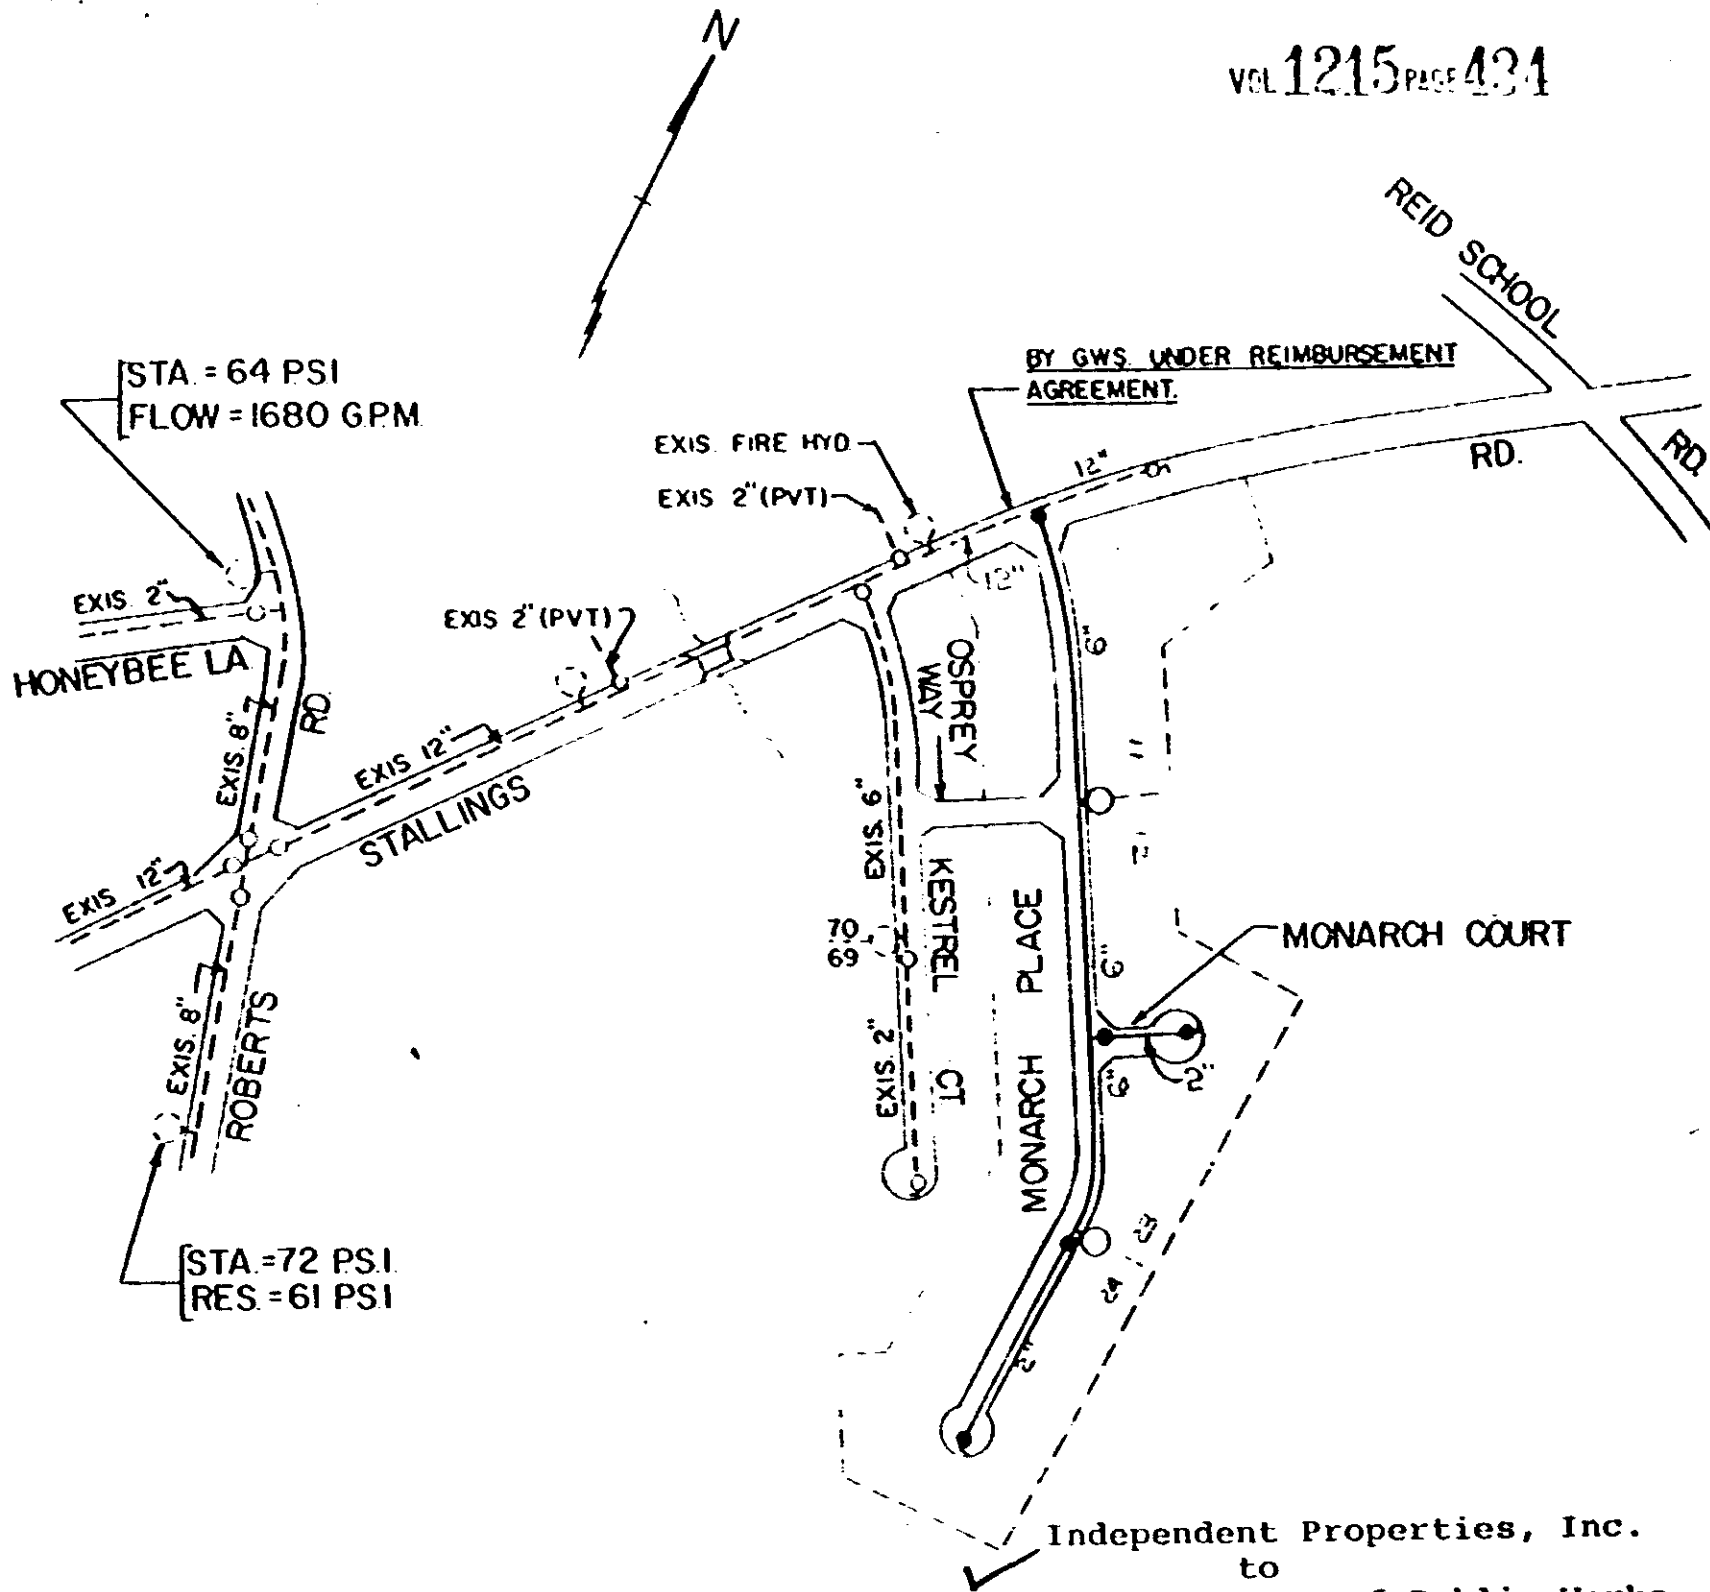

BY GWS UNDER REIMBURSEMENT AGREEMENT.

**NOTE:** 6" VALS OPEN RIGHT  
 2" VALS OPEN LEFT  
 FIRE HYD TO BE 3-WAY  
 & OPEN RIGHT

Independent Properties, Inc.  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 May 24, 1984  
 Blk. Book 525.3-1-3

Material List:

6" D. I. Pipe	-	1,400'±
2" Galv. Pipe	-	680'±
6" Valves	-	3
2" Valves	-	4
Fire Hydrants	-	2
Valve Boxes	-	7

WEDGEWOOD PLACE, SEC. II

AUG, 1983 SCALE 1" = 400'

40268

RECORDED JUN 21 1984 at 10:46 A.M.

4328-W-2