


NOTE: ALL 6" & 8" VALVES OPEN RIGHT  
 ALL 2" VALVES OPEN LEFT  
 ALL FIRE HYDRANTS TO BE  
 3-WAY & OPEN RIGHT

VOL 1025 PAGE 722

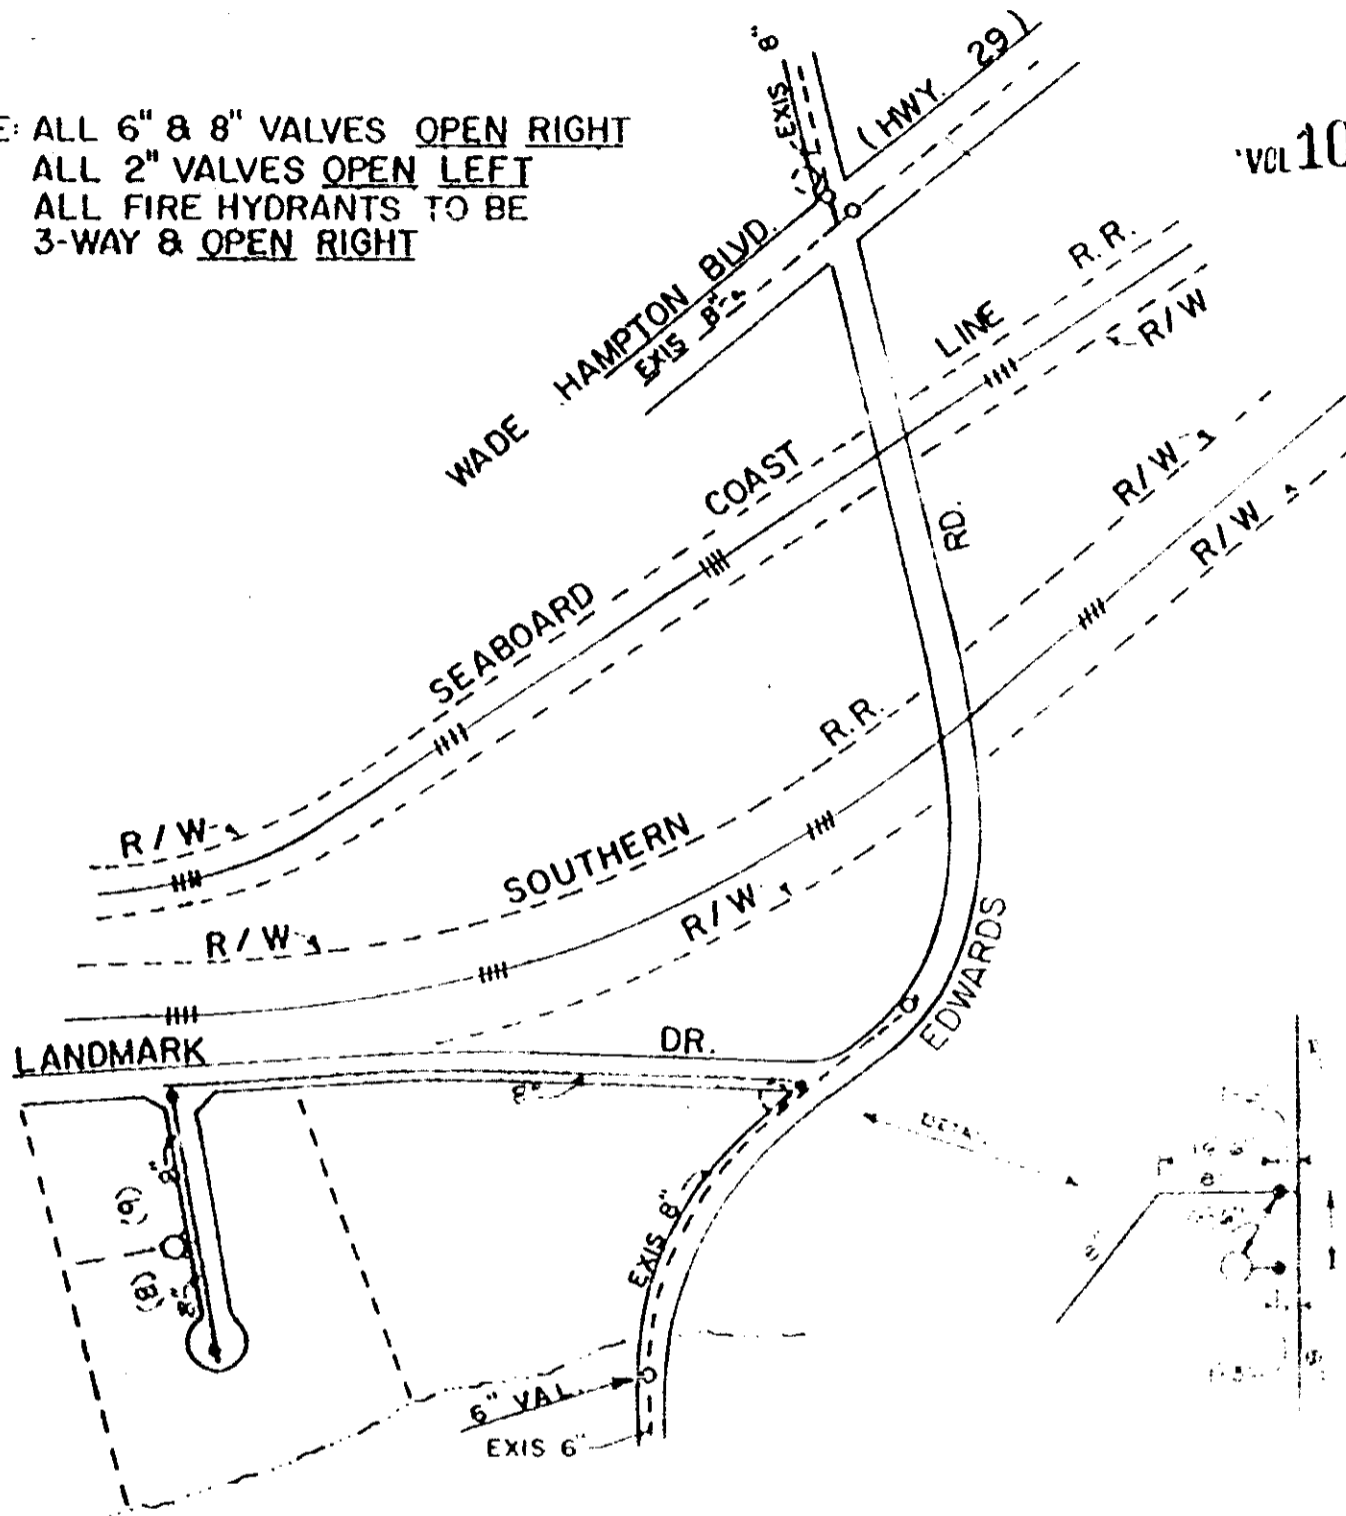

Material List:

8" C. I. Pipe	-	1,720 <sup>±</sup>
6" C. I. Pipe	-	10 <sup>±</sup>
8" Valves	-	2
6" Valves	-	1
2" Valve	-	1
Fire Hydrant	-	1

EDWARDS ROAD INDUSTRIAL CENTER

MAY, 1975 SCALE 1" = 400'

BLK. BOOK F-31-3-1

Dannon D. Jones

to

Commissioners of Public Works  
 of the City of Greenville, S.C.  
 September 12, 1975

9868

RECORDED OCT 13 '75 at 4:31 P.M.

4328 RV-2

972