


STATIC = 120 PSI.
FLOW = 1230 GPM

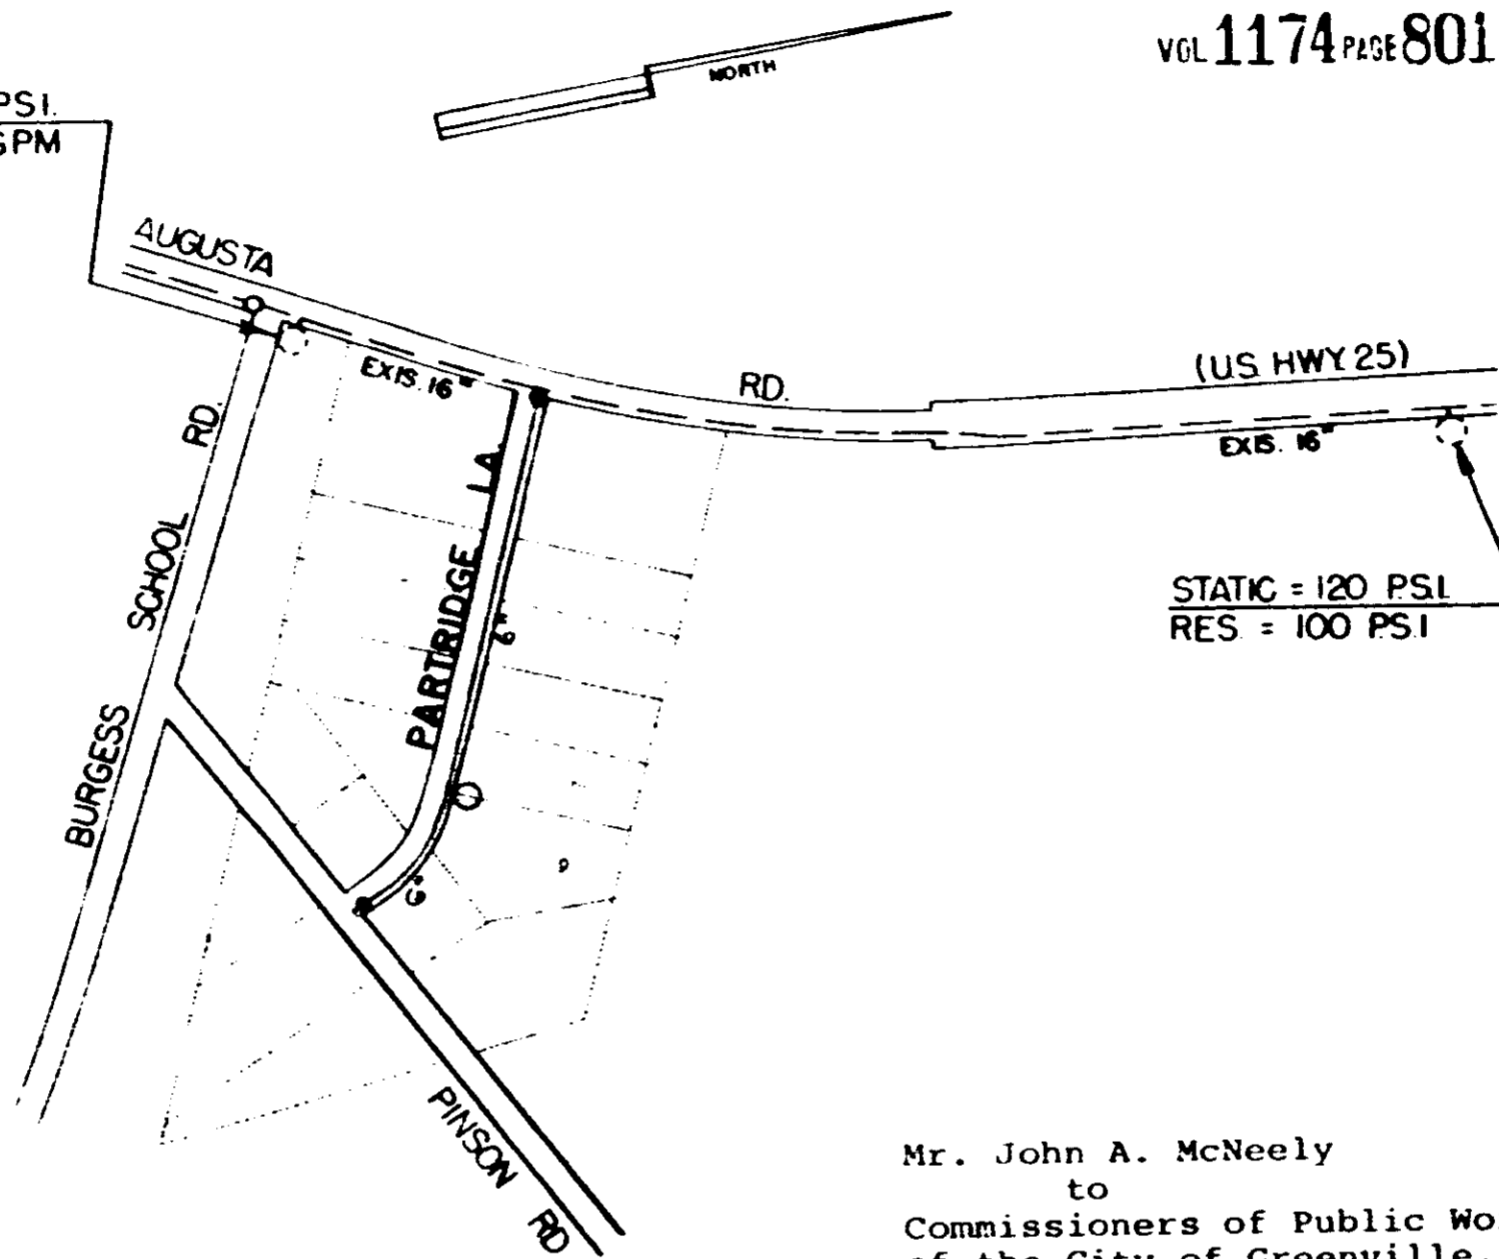

Mr. John A. McNeely
to
Commissioners of Public Works
of the City of Greenville, S. C.
September 13, 1982
Pt. of BLK. BOOK 604.3-1-1

NOTE: 6" VALS. OPEN RIGHT
2" VAL. OPEN LEFT
FIRE HYD. TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

6" D. I. Pipe	-	1,035'±
6" Valves	-	2
2" Valve	-	1
Valve Boxes	-	3
Fire Hydrant	-	1

PARTRIDGE HILL

AUG 1981 SCALE 1" = 400'
REV. OCT. 1981

7813

RECORDED SEP 30 1982 at 10:43 A.M.

0801

4325 RV-21