


B 5 3 0

VOL 1224 PAGE 358

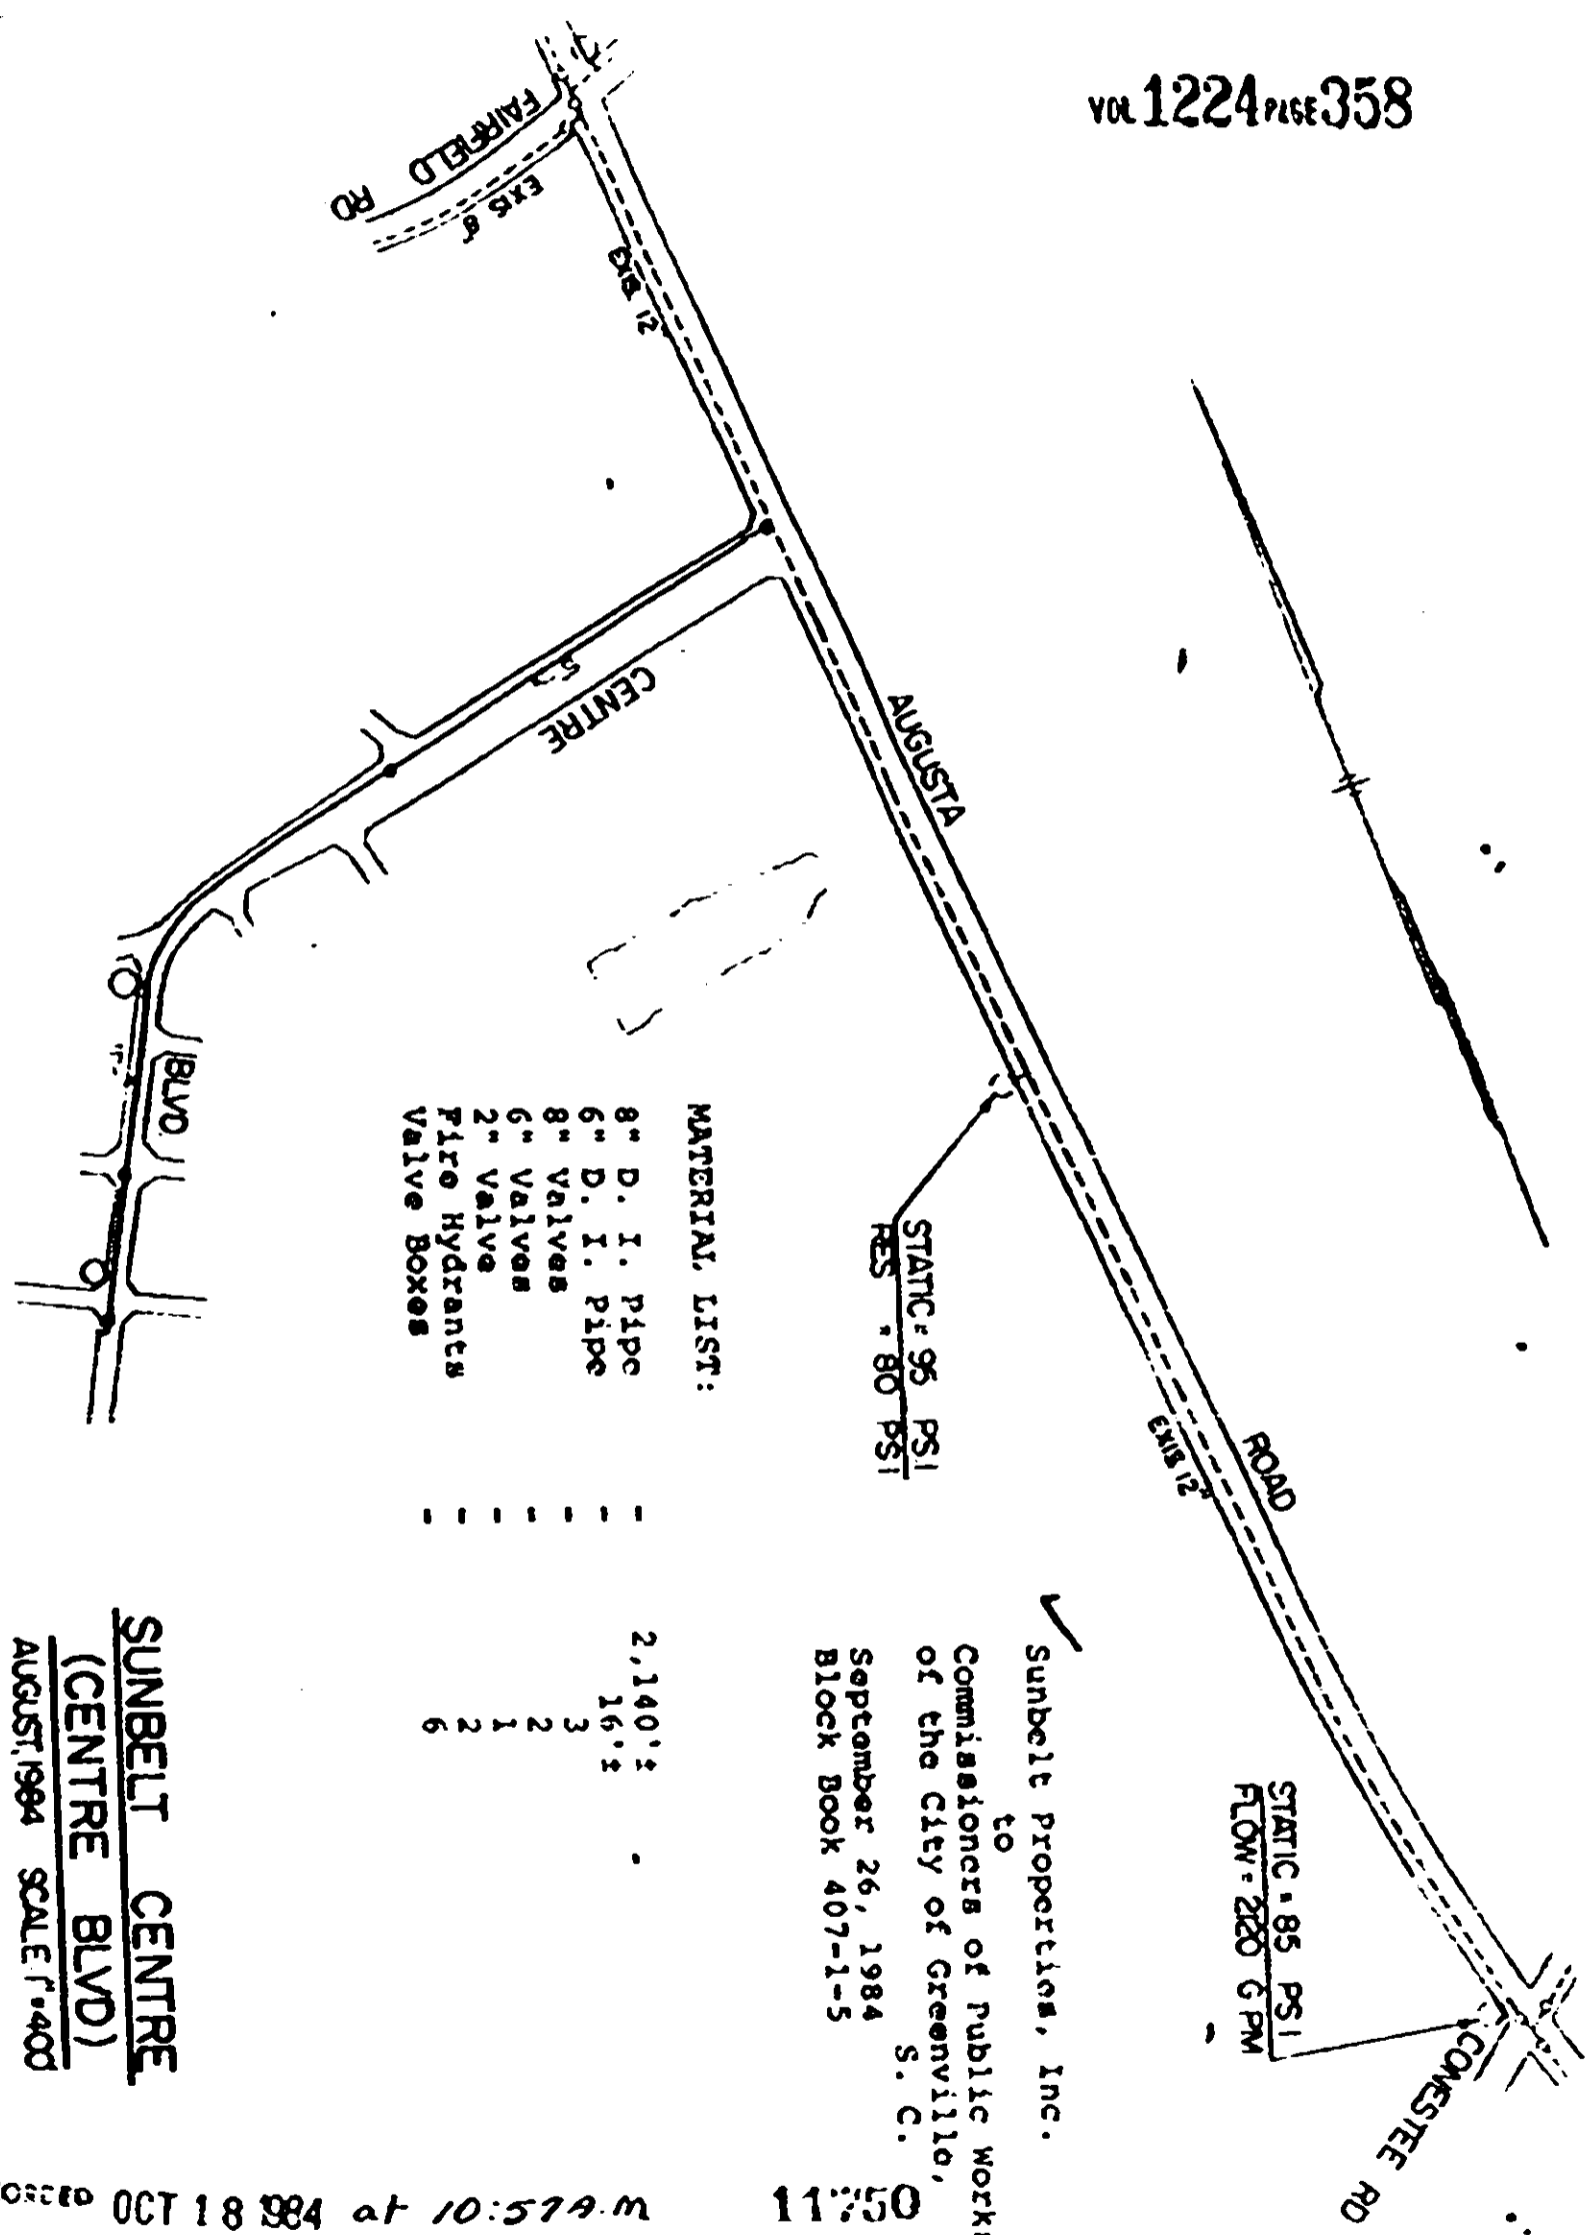

- MATERIAL LIST:
- 8" D. I. Pipe
 - 6" D. I. Pipe
 - 8" Valves
 - 6" Valves
 - 2" Valve
 - Fire Hydrants
 - Valve Boxes

2,140'±	2,140'±
16'±	16'±
3	3
2	2
1	1
2	2
6	6

STATIC: 95 PSI
RES: 80 PSI

STATIC: 85 PSI
FLOW: 220 GPM

✓ Sunbelt Properties, Inc.
to
Commissioners of Public Works
of the City of Greenville,
S. C.
September 26, 1984
Block Book 407-1-5

**SUNBELT CENTRE
(CENTRE BLVD)**
AUGUST, 1984 SCALE: 1"=400'

RECORDED OCT 18 1984 at 10:57A.M

11:50

12-11-84